

tel.: (+48 22) 825-04-71 (+48 22) 825-76-55 fax: (+48 22) 825-52-86

www.itb.pl





European Technical Assessment

ETA-17/0176 of 30/03/2017

General Part

Technical Assessment Body issuing the European Technical Assessment

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

Instytut Techniki Budowlanej

RDI ANCHOR

Deformation-controlled expansion anchors for use in non-cracked concrete

Rex Fastening Systems (HK) Ltd. Unit 2005, 20/F, Enterprise Square 3 39 Wang Chiu Road Kowloon Bay, Hong Kong

Manufacturing Plant no. 3

11 pages including 3 Annexes which form an integral part of this Assessment

European Assessment Document (EAD) 330232-00-0601 "Mechanical fasteners for use in concrete"

This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Specific Part

1 Technical description of the product

RDI ANCHOR are deformation-controlled expansion anchors. The anchors RDI ANCHOR are made of zinc plated steel.

The anchor is installed in a drilled hole and anchored by deformation-controlled expansion.

The description of the product is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performances given in Section 3 are only valid if the anchors are used in compliance with the specifications and conditions given in Annex B.

The performances given in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer or the Technical Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Performance of the product

3.1.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance, displacements	See Annexes C1 to C3
Edge distance and spacing	See Annexes C1 to C3

3.1.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchors satisfy requirements for Class A1
Resistance to fire	No performance assessed

3.2 Methods used for the assessment

The assessment of fitness of the anchors for the declared intended use in relation to the requirements for mechanical resistance and stability and safety in case of fire in the sense of the Basic Requirements 1 and 2 has been made in accordance with the EAD 330232-00-0601 "Mechanical fasteners for use in concrete".

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to Decision 96/582/EC of the European Commission the system of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table applies.

Product	Intended use	Level or class	System
Metal anchors for use in concrete	For fixing and/or supporting to concrete structural elements (which contributes to the stability of the works) or heavy units	_	1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document (EAD)

Technical details necessary for the implementation of the AVCP system are laid down in the control plan which is deposited at Instytut Techniki Budowlanej.

For type testing the results of the tests performed as part of the assessment for the European Technical Assessment shall be used unless there are changes in the production line or plant. In such cases the necessary type testing has to be agreed between Instytut Techniki Budowlanej and the notified body.

Issued in Warsaw on 30/03/2017 by Instytut Techniki Budowlanej

Marcin M. Kruk, PhD
Director of ITB

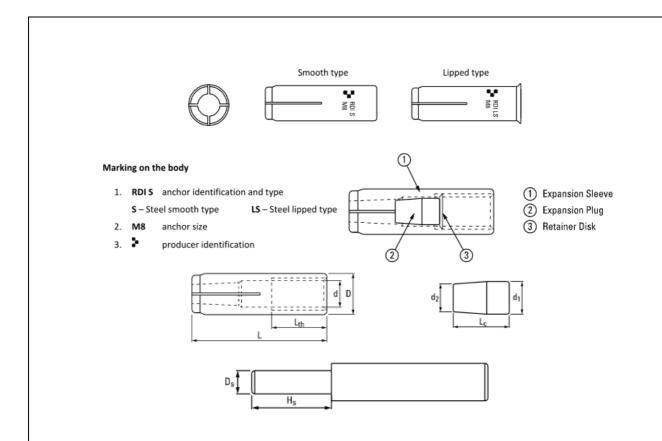


Table A1. RDI ANCHOR – dimensions and materials

Dimensions									
Anchor siz	ze		M8	M10	M12	M12D	M16	M20	
Expansion sleeve									
Sleeve diameter	D	mm	10	12	15	16	20	25	
Sleeve length	L	mm	30	40	50	50	65	80	
Thread	d	-	M8	M10	M12	M12	M16	M20	
Thread length	L_{th}	mm	13	17	21	21	30	30	
Expansion plug									
Plug diameter	d ₁	mm	6,5	8	10,1	10,1	13,5	17,3	
Plug diameter	d ₂	mm	5,5	6,5	8,5	8,5	11,4	16,3	
Plug length	L _c	mm	12	15	20	20	27	30	
Installation pin									
Setting pin diameter	Ds	mm	6,6	7,8	9,6	9,6	13,5	15,8	
Setting pin length	Hs	mm	18	25	30	30	38	50	
				Material	s				
Element				Material		Protection			
Expansion sle	eve		C)195 acc. to GB/T	700	zi	nc coating (≥ 5 µ	m);	
Expansion p	lug		G	195 acc. to GB/T	700	electroplated acc. to EN ISO 4042			

RDI ANCHOR

Product description

Characteristic of the product

Annex A1

SPECIFICATION OF INTENDED USE

Anchorages subject to:

Static and quasi-static loads.

Base material:

- Reinforced or unreinforced normal weight concrete of strength class C20/25 at minimum to C50/60 at maximum according to EN 206.
- Non-cracked concrete.

Use conditions (environmental conditions):

Structures subject to dry internal conditions.

Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be transmitted. The
 position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to
 reinforcement or to supports, etc.).
- Anchorages under static and quasi-static loads are designed in accordance with EOTA Technical Report TR 055.

Installation:

- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Use of the anchor only as supplied by the manufacturer without exchanging any component of the anchor.
- Anchor installation in accordance with the manufacturer's specifications and drawings and using the appropriate tools.
- Check of concrete being well compacted, e.g. without significant voids.
- Positioning of the drill holes without damaging the reinforcement.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted drill hole is filled with high strength mortar and if under shear or oblique tension load it is not in the direction of load application.
- Anchor installation such that the effective anchorage depth is complied with.

RDI ANCHOR	Annex B1
Intended use Specification	of European Technical Assessment ETA-17/0176

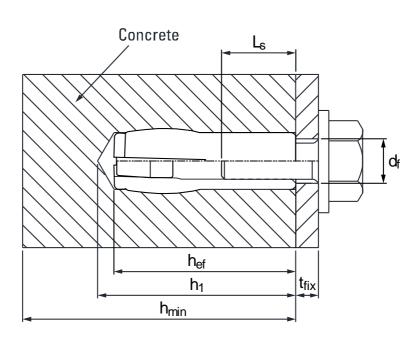



Table B1: Installation parameters

Anchor	RDI ANCHOR								
Size			M8	M10	M12	M12D	M16	M20	
Effective anchorage depth	h _{ef}	[mm]	30	40	50	50	65	80	
Drill hole depth	h₁	[mm]	33	43	54	54	70	85	
Drill hole diameter	d ₀	[mm]	10	12	15	16	20	25	
Installation torque (max)	T _{inst}	[mm]	8	15	35	35	60	120	
Thickness of concrete member (min)	h _{min}	[mm]	100	100	100	100	130	160	
Screwing depth (min)	L _{s, min}	[mm]	8	10	12	12	16	20	
Screwing depth (max)	L _{s, max}	[mm]	13	17	21	21	30	30	
Diameter of clearance hole in the fixture	d _f	[mm]	9	12	14	14	18	22	
Spacing (min)	S _{min}	[mm]	41	54	68	68	88	108	
Edge distance (min)	C _{min}	[mm]	41	54	68	68	88	108	

Fastening screws or anchor threaded rods:

Steel, property class 4.6 / 4.8 / 5.8 / 6.8 / 8.8 according to EN-ISO 898-1; thickness of galvanizing \geq 5 μm

RDI ANCHOR	Annex B2
Intended use Installation parameters	of European Technical Assessment ETA-17/0176

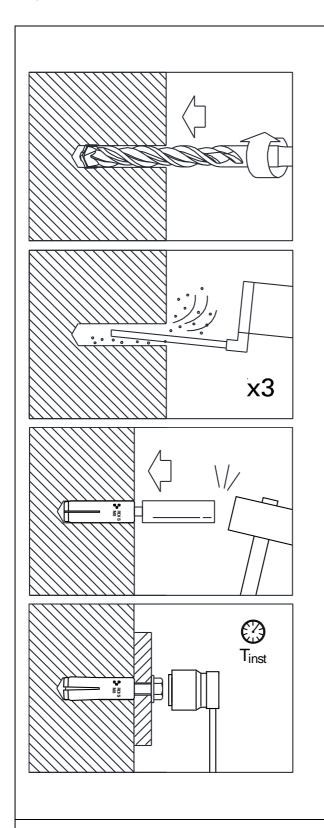

Drill hole with rotary percussive machine. Drill to a required depth.

Blow out dust at least 3 times with a hand pump.

Put the anchor into the drill hole, hammering with the installation tool, until the setting pin fully insert into the anchor.

Fix the fixture by screw or threaded rod with max. $\boldsymbol{T}_{\text{inst}}.$

RDI ANCHOR

Intended use Installation instruction and tools

Annex B3

Table C1: Characteristic resistance to tension load in non-cracked concrete (static and quasi-static loading)

Anchor		RDI ANCHOR							
Size				М8	M10	M12	M12D	M16	M20
Steel failure									
Steel failure with	h threaded rod grade 4.6								
Characteristic re	esistance	$N_{Rk,s}$	[kN]	14,6	23,2	33,7	33,7	62,8	98,0
Partial safety fa	ctor	γ _{Ms} ²⁾	[-]	2,0	2,0	2,0	2,0	2,0	2,0
Steel failure with	h threaded rod grade 4.8								
Characteristic re	esistance	$N_{Rk,s}$	[kN]	14,6	23,2	33,7	33,7	62,8	98,0
Partial safety fa	ctor	γ _{Ms} ²⁾	[-]	1,5	1,5	1,5	1,5	1,5	1,5
Steel failure with	h threaded rod grade 5.8								
Characteristic re	esistance	$N_{Rk,s}$	[kN]	18,3	29,0	42,2	42,2	78,5	122,5
Partial safety fa	ctor	γ _{Ms} ²⁾	[-]	1,5	1,5	1,5	1,5	1,5	1,5
Steel failure with	h threaded rod grade 6.8								
Characteristic re	esistance	$N_{Rk,s}$	[kN]	22,0	34,8	50,6	50,6	94,2	147,0
Partial safety fa	ctor	γ _{Ms} ²⁾	[-]	1,5	1,5	1,5	1,5	1,5	1,5
Steel failure with	h threaded rod grade 8.8								
Characteristic re	esistance	$N_{Rk,s}$	[kN]	29,3	46,4	67,4	67,4	125,6	196,0
Partial safety fa	ctor	γ _{Ms} ²⁾	[-]	1,5	1,5	1,5	1,5	1,5	1,5
Pullout failure									
Characteristic re		$N_{Rk,p}$	[kN]	1)	1)	1)	1)	25	30
Installation safe	ty factor	$\gamma_2^{(3)} = \gamma_{inst}^{(4)(5)}$	[-]	1,2	1,2	1,4	1,2	1,2	1,2
	concrete C30/37		[-]	1,22	1,22	1,22	1,22	1,22	1,22
Increasing factor	concrete C40/50	Ψc	[-]	1,41	1,41	1,41	1,41	1,41	1,41
	concrete C50/60		[-]	1,55	1,55	1,55	1,55	1,55	1,55
Concrete cone	failure and splitting failu	ıre							
Effective embed	dment depth	h _{ef}	[mm]	30	40	50	50	65	80
Factor for non-c	cracked concrete	$k_1^{(3)} = k_{ucr}^{(4)}$	[-]	10,1	10,1	10,1	10,1	10,1	10,1
Factor for non-c	cracked concrete	k _{ucr,N} ⁵⁾	[-]	11,0	11,0	11,0	11,0	11,0	11,0
Installation safe	ty factor	$\gamma_2^{(3)} = \gamma_{\text{inst}}^{(4)(5)}$	[-]	1,2	1,2	1,4	1,2	1,2	1,2
	concrete C30/37		[-]	1,22	1,22	1,22	1,22	1,22	1,22
Increasing factor	concrete C40/50	Ψc	[-]	1,41	1,41	1,41	1,41	1,41	1,41
	concrete C50/60		[-]	1,55	1,55	1,55	1,55	1,55	1,55
Characteristic re	esistance to splitting	$N^0_{Rk,sp}$	[kN]	1)	1)	1)	1)	25	30
Characteristic	concrete cone failure	S _{cr,N}	[mm]	90	120	150	150	195	240
spacing	splitting failure	S _{cr,sp}	[mm]	210	280	350	350	455	560
Characteristic	concrete cone failure	C _{cr,N}	[mm]	45	60	75	75	97	120
edge distance	splitting failure	C _{cr,sp}	[mm]	105	140	175	175	227	280

RDI	A 1 1	\sim 11	
W111	ΔN		()

Performances

Characteristic resistance to tension load

Annex C1

Anchor			RDI ANCHOR						
Size			M8	M10	M12	M12D	M16	M20	
Steel failure without lever arm									
Steel failure with threaded rod grade 4.6									
Characteristic resistance	$V_{Rk,s}^{3)4} = V_{Rk,s}^{0}^{5}$	[kN]	7,3	11,6	31,4	16,9	31,4	49,0	
Factor considering ductility	$k^{3)} = k_2^{4)} = k_7^{5)}$	[-]	0,8	0,8	0,8	0,8	0,8	0,8	
Partial safety factor	γ _{Ms} ²⁾	[-]	1,67	1,67	1,67	1,67	1,67	1,67	
Steel failure with threaded rod grade 4.8					•				
Characteristic resistance	$V_{Rk,s}^{3)4} = V_{Rk,s}^{0}^{5}$	[kN]	7,3	11,6	31,4	16,9	31,4	49,0	
Factor considering ductility	$k^{3)} = k_2^{4)} = k_7^{5)}$	[-]	0,8	0,8	0,8	0,8	0,8	0,8	
Partial safety factor	γ _{Ms} ²⁾	[-]	1,25	1,25	1,25	1,25	1,25	1,25	
Steel failure with threaded rod grade 5.8									
Characteristic resistance	$V_{Rk,s}^{3)4)} = V_{Rk,s}^{0}^{5)}$	[kN]	9,2	14,5	39,3	21,1	39,3	61,3	
Factor considering ductility	$k^{3)} = k_2^{4)} = k_7^{5)}$	[-]	0,8	0,8	0,8	0,8	0,8	0,8	
Partial safety factor	γ _{Ms} ²⁾	[-]	1,25	1,25	1,25	1,25	1,25	1,25	
Steel failure with threaded rod grade 6.8									
Characteristic resistance	$V_{Rk,s}^{3)4)} = V_{Rk,s}^{0}^{5)}$	[kN]	11,0	17,4	47,1	25,3	47,1	73,5	
Factor considering ductility	$k^{3)} = k_2^{4)} = k_7^{5)}$	[-]	0,8	0,8	0,8	0,8	0,8	0,8	
Partial safety factor	γ _{Ms} ²⁾	[-]	1,25	1,25	1,25	1,25	1,25	1,25	
Steel failure with threaded rod grade 8.8									
Characteristic resistance	$V_{Rk,s}^{3)4)} = V_{Rk,s}^{0}^{5)}$	[kN]	14,6	23,2	62,8	33,7	62,8	98,0	
Factor considering ductility	$k^{3)} = k_2^{4)} = k_7^{5)}$	[-]	0,8	0,8	0,8	0,8	0,8	0,8	
Partial safety factor	γ _{Ms} ²⁾	[-]	1,25	1,25	1,25	1,25	1,25	1,25	
Steel failure with lever arm									
Steel failure with threaded rod grade 4.6									
Characteristic bending resistance	$M^0_{Rk,s}$	[Nm]	15,0	29,9	52,4	52,4	133,3	259,8	
Partial safety factor	γ _{Ms} ²⁾	[-]	1,67	1,67	1,67	1,67	1,67	1,67	
Steel failure with threaded rod grade 4.8									
Characteristic bending resistance	$M^0_{Rk,s}$	[Nm]	15,0	29,9	52,4	52,4	133,3	259,8	
Partial safety factor	γ _{Ms} ²⁾	[-]	1,25	1,25	1,25	1,25	1,25	1,25	
Steel failure with threaded rod grade 5.8									
Characteristic bending resistance	$M^0_{Rk,s}$	[Nm]	18,8	37,4	65,6	65,6	166,6	324,8	
Partial safety factor	γ _{Ms} ²⁾	[-]	1,25	1,25	1,25	1,25	1,25	1,25	
Steel failure with threaded rod grade 6.8				.					
Characteristic bending resistance	M ⁰ _{Rk,s}	[Nm]	22,5	44,9	78,7	78,7	199,9	389,7	
Partial safety factor	γ _{Ms} ²⁾	[-]	1,25	1,25	1,25	1,25	1,25	1,25	
Steel failure with threaded rod grade 8.8									
Characteristic bending resistance	$M^0_{Rk,s}$	[Nm]	30,0	59,9	104,9	104,9	266,6	519,	
Partial safety factor	γ _{Ms} ²⁾	[-]	1,25	1,25	1,25	1,25	1,25	1,25	

RDI ANCHOR

Performances

Characteristic resistance to shear loads

Annex C2

Table C3: Characteristic resistance and displacements (static and quasi-static loading)

Anchor			RDI ANCHOR					
Size	M8	M10	M12	M12D	M16	M20		
Resistance to pry-out failure								
Factor for non-cracked concrete	$k^{3)} = k_3^{4)} = k_8^{5)}$	[-]	1,0	1,0	1,0	1,0	2,0	2,0
Partial safety factor	γ _{Ms} ²⁾	[-]	1,5	1,5	1,5	1,5	1,5	1,5
Resistance to concrete edge failure								
Outside diameter of anchor	d _{nom}	[mm]	10	12	15	16	20	25
Effective length of anchor under shear loads	l _f	[mm]	30	40	50	50	65	80
Partial safety factor	γ _{Mc} ²⁾	[-]	1,5	1,5	1,5	1,5	1,5	1,5
Minimum member thickness	h _{min}	[mm]	100	100	100	100	130	160
Minimum edge distance	C _{min}	[mm]	41	54	68	68	88	108
Minimum spacing	S _{min}	[mm]	41	54	68	68	88	108
Displacements under static and quasi-	static loading							
Tension and shear load in non-cracked co	oncrete C20/25 to C5	0/60						
Tension load and shear load	N = V	[kN]	4,44	6,91	6,40	9,92	11,46	23,86
Short term tension displacement	δ_{N0}	[mm]	0,98	3,54	3,06	2,73	1,15	4,26
Long term tension displacement	$\delta_{N^{\!\scriptscriptstyle{\infty}}}$	[mm]	0,50	0,50	0,38	0,50	0,50	0,50
Short term shear displacement	δ_{V0}	[mm]	0,98	3,54	3,06	2,73	1,15	4,26
Long term shear displacement	δ_{V^∞}	[mm]	0,50	0,50	0,38	0,50	0,50	0,50

RDI	A NI	\sim L	\sim	D
RUI	AIN	UГ	JU	П

Performances Characteristic resistance and displacements

Annex C3

¹⁾ Pull-out failure mode is not decisive
2) 3) Parameter for design acc. to ETAG 001 Annex C

Parameter for design acc. to CEN/TS 1992-4-4:2009
Parameter for design acc. to prEN 1992-4:2016



tel.: (+48 22) 825-04-71 (+48 22) 825-76-55 fax: (+48 22) 825-52-86

www.itb.pl





European Technical Assessment

ETA-17/0177 of 30/03/2017

General Part

Technical Assessment Body issuing the European Technical Assessment

Trade name of the construction product F

Product family to which the construction product belongs

RDI ANCHOR

Instytut Techniki Budowlanej

Deformation-controlled expansion anchors for multiple use for non-structural applications in concrete

Manufacturer

Rex Fastening Systems (HK) Ltd. Unit 2005, 20/F, Enterprise Square 3 39 Wang Chiu Road Kowloon Bay, Hong Kong

Manufacturing plant(s)

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

Manufacturing Plant no. 3

10 pages including 3 Annexes which form an integral part of this assessment

Guideline for European Technical Approval ETAG 001, Edition April 2013 "Metal anchors for use in concrete – Part 1: Anchors in general and Part 6: Anchors for multiple use for non-structural applications", used as European Assessment Document (EAD)

This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Specific Part

1 Technical description of the product

The RDI ANCHOR are deformation-controlled expansion anchors. The anchors are made of zinc plated steel.

The anchor is installed in a drilled hole and anchored by deformation-controlled expansion.

The description of the product is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performances given in Section 3 are only valid if the anchors are used in compliance with the specifications and conditions given in Annex B.

The performances given in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer or the Technical Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Performance of the product

3.1.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for all load directions	See Annex C1
Edge distances and spacing	See Annex C1

3.1.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchors satisfy requirements for Class A1
Resistance to fire	See Annex C2

3.1.3 Hygiene, health and the environment (BWR 3)

Regarding the dangerous substances clauses contained in this European Technical Assessment, there may be requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

3.1.4 Safety and accessibility in use (BWR 4)

For Basic Requirement Safety in use the same criteria are valid as for Basic Requirement Mechanical resistance and stability (BWR 1).

3.1.5 Sustainable use of natural resources (BWR 7)

No performance assessed.

3.1.6 General aspects relating to fitness for use

Durability and serviceability are only ensured if the specifications of intended use according to Annex B1 are kept.

3.2 Methods used for the assessment

The assessment of fitness of the anchors for the declared intended use in relation to the requirements for mechanical resistance and stability and safety in use in the sense of the Basic Requirements 1 and 4 has been made in accordance with the ETAG 001 "Metal anchors for use in concrete", Part 1: "Anchors in general" and Part 6: "Anchors for multiple use for non-structural applications".

The assessment of the anchor for the intended use in relation to the requirements for resistance to fire has been made in accordance with the EOTA Technical Report TR 020 "Evaluation of anchorages in concrete concerning resistance to fire".

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to Decision 97/161/EC of the European Commission the system of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table applies.

Product	Intended use	Level or class	System
Metal anchors for use in concrete (light-duty type)	For use in redundant systems for fixing and/or supporting to concrete elements such as lightweight suspended ceilings, as well as installations	-	2+

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document (EAD)


Technical details necessary for the implementation of the AVCP system are laid down in the control plan which is deposited at Instytut Techniki Budowlanej.

For type testing the results of the tests performed as part of the assessment for the European Technical Assessment shall be used unless there are changes in the production line or plant. In such cases the necessary type testing has to be agreed between Instytut Techniki Budowlanej and the notified body.

Issued in Warsaw on 30/03/2017 by Instytut Techniki Budowlanej

Marcin M. Kruk, PhD

Director of ITB

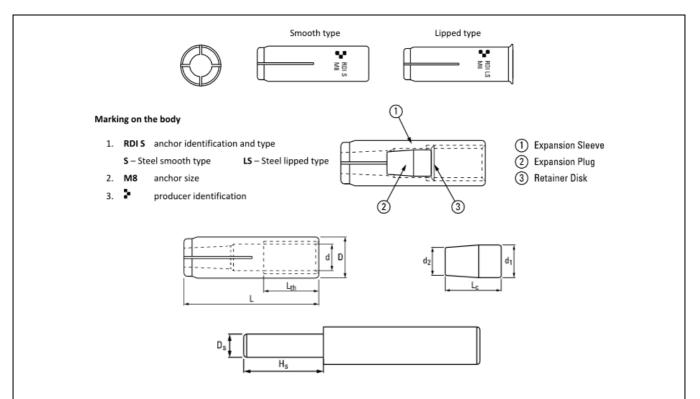

Dimensions								
Anchor size			М6	M8	M10H	M10	M12	M12D
Expansion sleeve								
Sleeve diameter	D	[mm]	8	10	12	12	15	16
Sleeve length	L	[mm]	25	30	30	40	50	50
Thread	d	[-]	M6	M8	M10	M10	M12	M12
Thread length	L _{th}	[mm]	11	13	12	17	21	21
Expansion plug								
Plug diameter	d ₁	[mm]	5,0	6,5	8,0	8,0	10,1	10,1
Plug diameter	d ₂	[mm]	4,0	5,5	6,9	6,5	8,5	8,5
Plug length	Lc	[mm]	10	12	11	15	20	20
Installation pin								
Setting pin diameter	Ds	[mm]	4,8	6,6	7,8	7,8	9,6	9,6
Setting pin length	Hs	[mm]	15	18	18	25	30	30
Materials								
Element		Material			Protec	tion		
Expansion sleeve		Q195 acc. to GB/T 700			zinc co	zinc coating (≥ 5 μm);		
Expansion plug		Q195 acc. t	o GB/T 700				EN ISO 4042	2

RDI ANCHOR	Annex A1
Product description Characteristic of the product	of European Technical Assessment ETA-17/0177

SPECIFICATION OF INTENDED USE

Anchorages subject to:

- Multiple use for non-structural applications. The definition of multiple use according to the Member States is given on the informative Annex 1 of ETAG 001, Part 6.
- Static and quasi-static loads.
- Anchorages with requirements related to resistance to fire.

Base material:

- Reinforced or unreinforced normal weight concrete of strength class C20/25 at minimum to C50/60 at maximum according to EN 206.
- Non-cracked and cracked concrete.

Use conditions (environmental conditions):

Structures subject to dry internal conditions.

Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be transmitted. The
 position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to
 reinforcement or to supports, etc.).
- Anchorages under static and quasi-static loads are designed in accordance with ETAG 001, Annex C, design method B, Edition August 2010.
- The design of anchorages under fire exposure has to consider the conditions given in the EOTA Technical Report TR 020.

Installation:

- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Use of the anchor only as supplied by the manufacturer without exchanging any component of the anchor.
- Anchor installation in accordance with the manufacturer's specifications and drawings and using the appropriate tools.
- Check of concrete being well compacted, e.g. without significant voids.
- Positioning of the drill holes without damaging the reinforcement.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted drill hole is filled with high strength mortar and if under shear or oblique tension load it is not in the direction of load application.
- Anchor installation such that the effective anchorage depth is complied with.

RDI ANCHOR	Annex B1
Intended use Specification	of European Technical Assessment ETA-17/0177

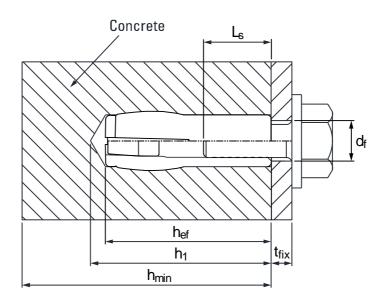



Table B1: Installation parameters

Anchor			RDI ANCHOR							
Size			M6	M8	M10H	M10	M12	M12D		
Effective anchorage depth	h _{ef}	[mm]	25	30	30	40	50	50		
Drill hole depth	h₁	[mm]	28	33	33	43	54	54		
Drill hole diameter	d_0	[mm]	8	10	12	12	15	16		
Installation torque (max)	T _{inst}	[mm]	4	8	15	15	35	35		
Thickness of concrete member (min)	h _{min}	[mm]	80	80	80	80	100	100		
Screwing depth (min)	L _{s, min}	[mm]	6	8	8	10	12	12		
Screwing depth (max)	L _{s, max}	[mm]	11	13	12	17	21	21		
Diameter of clearance hole in the fixture	d _f	[mm]	7	9	12	12	14	14		
Spacing (min)	S _{min}	[mm]	200	200	200	200	200	200		
Edge distance (min)	C _{min}	[mm]	150	150	150	150	150	150		

Fastening screws or anchor threaded rods:

Steel, property class 4.6 / 4.8 / 5.8 / 6.8 / 8.8 according to EN-ISO 898-1; thickness of galvanizing \geq 5 μm

RDI ANCHOR Annex B2 of European Technical Assessment ETA-17/0177

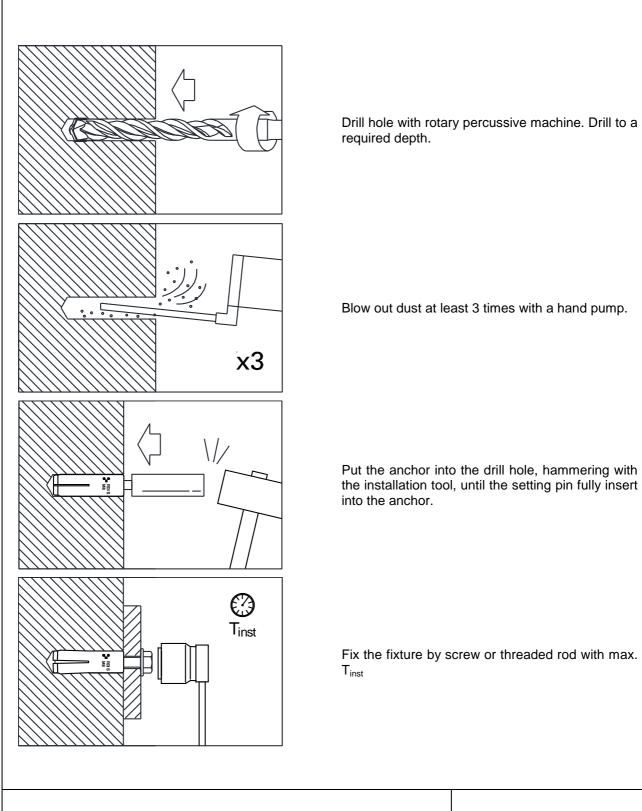

RDI ANCHOR

Intended use Installation instruction and tools

Annex B3

Table C1: Characteristic resistance in concrete C20/25 to C50/60 (design acc. to ETAG 001, Annex C, method B)

Anchor	RDI ANCHOR							
Size			M6	M8	M10H	M10	M12	M12D
All load directions (fastening screw or threaded	rod propert	y class ≥	4.6)					
Characteristic resistance in concrete C20/25 to C50/60	F_{Rk}	[kN]	1,5	2,0	3,0	3,0	4,0	5,0
Partial (installation) safety factor	γ ₂	[-]	1,4	1,4	1,4	1,4	1,4	1,4
Spacing	S _{cr}	[mm]	200	200	200	200	200	200
Edge distance	C _{cr}	[mm]	150	150	150	150	150	150
Minimum member thickness	h _{min}	[mm]	80	80	80	80	100	100
Shear load: steel failure with lever arm							•	
Characteristic bending moment: screw class 4.6	$M^0_{Rk,S}$	[Nm]	6,1	15,0	29,9	29,9	52,4	52,4
Characteristic bending moment: screw class 4.8	M ⁰ _{Rk,S}	[Nm]	6,1	15,0	29,9	29,9	52,4	52,4
Characteristic bending moment: screw class 5.8	M ⁰ _{Rk,S}	[Nm]	7,6	18,8	37,4	37,4	65,6	65,6
Characteristic bending moment: screw class 6.8	M ⁰ _{Rk,S}	[Nm]	9,2	22,5	44,9	44,9	78,7	78,7
Characteristic bending moment: screw class 8.8	M ⁰ _{Rk,S}	[Nm]	12,2	30,0	59,9	59,9	104,9	104,9

RDI ANCHOR

PerformancesCharacteristic resistance

Annex C1

Table C2: Characteristic resistance under fire exposure in concrete C20/25 to C50/60 (design acc. to ETAG 001, Annex C, method B)

Anchor			RDI AN	ICHOR				
Size	Size					M10	M12	M12D
Fire resistance class (fastening	erty class ≥	4.6)						
R30		[kN]	0,2	0,5	0,8	0,8	1,0	1,3
R60	Characteristic resistance	[kN]	0,2	0,5	0,8	0,8	1,0	1,3
R90	F _{Rk,fi} 1)	[kN]	0,1	0,4	0,8	0,8	1,0	1,1
R120		[kN]	0,1	0,3	0,6	0,6	0,8	0,8
Spacing	S _{cr,fi}	[mm]			4 x	h _{ef}		
Edge distance	C _{cr,fi}	[mm]	2 x h _{ef}					

The design method covers anchors with a fire attack from one side only. In case of fire attack from more than one side, the edge distance shall be \geq 300 mm. ¹⁾ in the absence of other national regulations a partial safety factor $\gamma_{m,fi}$ = 1,0 is recommended

RDI	ΛÞ	ALC:	$\Box \cap$	D

PerformancesCharacteristic resistance under fire exposure

Annex C2



tel.: (+48 22) 825-04-71 (+48 22) 825-76-55 fax: (+48 22) 825-52-86

www.itb.pl





European Technical Assessment

ETA-17/0325 of 10/04/2017

General Part

Technical Assessment Body issuing the European Technical Assessment

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant

contains
This European Technical Assessment

This European Technical Assessment

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

Instytut Techniki Budowlanej

CMH ANCHOR

Deformation-controlled expansion anchor made of galvanized steel for multiple use for non-structural applications in concrete

Construction Anchors Co., Ltd. 9F, No. 21, Sec. 3, Xinsheng S.Rd., Da'an Dist, Taipei City 106 Taiwan R.O.C.Hong Kong

Manufacturing Plant no. 4

9 pages including 3 Annexes which form an integral part of this assessment

Guideline for European Technical Approval ETAG 001, Edition April 2013 "Metal anchors for use in concrete – Part 1: Anchors in general and Part 6: Anchors for multiple use for non-structural applications", used as European Assessment Document (EAD)

This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Specific Part

1 Technical description of the product

CMH ANCHOR of size Ø6 is deformation-controlled expansion anchor. CMH ANCHOR is made of galvanized steel. The anchor is installed in a drilled hole and anchored by deformation-controlled expansion.

An illustration of the product is given in Annex A1.

2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performances given in Section 3 are only valid if the anchors are used in compliance with the specifications and conditions given in Annex B1 and B2.

The performances given in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer or the Technical Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Performance of the product

3.1.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for all load directions	See Annex C1
Edge distances and spacing	See Annex C1

3.1.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchors satisfy requirements for Class A1
Characteristic resistance under fire exposure	See Annex C2

3.1.3 Hygiene, health and the environment (BWR 3)

Regarding the dangerous substances there may be requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

3.1.4 Safety and accessibility in use (BWR 4)

For Basic Requirement Safety in use the same criteria are valid as for Basic Requirement Mechanical resistance and stability (BWR 1).

3.1.5 Sustainable use of natural resources (BWR 7)

No performance assessed.

3.1.6 General aspects relating to fitness for use

Durability and serviceability are only ensured if the specifications of intended use according to Annex B1 are kept.

3.2 Methods used for the assessment

The assessment of fitness of the anchors for declared intended use in relation to the requirements for mechanical resistance and stability and safety in use in the sense of the Basic Requirements 1 and 4 has been made in accordance with the ETAG 001 "Metal anchors for use in concrete", Part 1: "Anchors in general" and Part 6: "Anchors for multiple use for non-structural applications".

The assessment of the anchor for the intended use in relation to the requirements for resistance to fire has been made in accordance with the EOTA Technical Report TR 020 "Evaluation of anchorages in concrete concerning resistance to fire".

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to Decision 97/161/EC of the European Commission the system of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table applies.

Product	Intended use	Level or class	System
Metal anchors for use in concrete (light-duty type)	For use in redundant systems for fixing and/or supporting to concrete elements such as lightweight suspended ceilings, as well as installations	_	2+


5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document (EAD)

Technical details necessary for the implementation of the AVCP system are laid down in the control plan which is deposited at Instytut Techniki Budowlanej.

For type testing the results of the tests performed as part of the assessment for the European Technical Assessment shall be used unless there are changes in the production line or plant. In such cases the necessary type testing has to be agreed between Instytut Techniki Budowlanej and the notified body.

Issued in Warsaw on 10/04/2017 by Instytut Techniki Budowlanej

Anna Panek, MSc Deputy Director of ITB

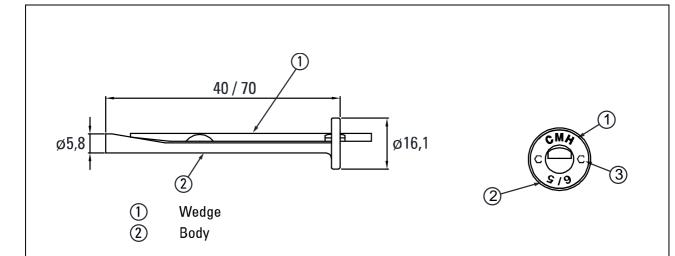

Marking on the body

1. **CMH** anchor identification

2. **6/5** anchor size / maximum fixture thickness

3. **C** producer identification

Table A1. CMH ANCHOR – dimensions and materials

CMH ANCHOR		CMH 6/5	CMH 6/35	
Anchor nominal size		6		
Length of wedge	mm	43	73	
Length of shank	mm	40 70		
Diameter	mm	5,8		
Materials	wedge	steel 45 (GB/T 699) / C45 / 1.0503 acc. to EN 10277-2 (tensile strength f_{uk} = 600 N/mm ²) zinc coated		
Iviateriais	shank	steel ML08Al (GB/T 6478) / C8C / 1.0213 acc. to EN 10263-2 (tensile strength f_{uk} = 420 N/mm 2) zinc coated		

CMH ANCHOR	Annex A1
Product description Characteristic of the product	of European Technical Assessment ETA-17/0325

SPECIFICATION OF INTENDED USE

Anchorages subject to:

- Multiple use for non-structural applications.
- Static and quasi-static loads.
- Anchorages with requirements related to resistance to fire.

Base material:

- Reinforced or unreinforced normal weight concrete of strength class C20/25 at minimum to C50/60 at maximum according to EN 206.
- Cracked and non-cracked concrete.

Use conditions (environmental conditions):

Dry internal conditions.

Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete
 work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be transmitted. The
 position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to
 reinforcement or to supports, etc.).
- Anchorages under static and quasi-static loads are designed in accordance with ETAG 001, Annex C, design method C, Edition August 2010.
- The design of anchorages under fire exposure has to consider the conditions given in the EOTA Technical Report TR 020.
- Fasteners are only to be used for multiple use for non-structural applications acc. to ETAG 001, Part 6, Edition August 2010.

Installation:

- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Anchor installation in accordance with the manufacturer's specifications and drawings and using the appropriate tools.
- Edge distance and spacing not less than the specified values without minus tolerances.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted drill hole is filled with high strength mortar and if under shear or oblique tension load it is not the direction of load application.
- Anchor installation such that the effective anchorage depth is complied with; the compliance is ensured if the thickness of the fixture is not larger than the maximum values given in Annex B2.
- Anchor expansion by impact on the wedge of the anchor; the anchor is properly set if the wedge is fully dropped in.
- Anchor can only be set once.

CMH ANCHOR	Annex B1
Intended use Intended use	of European Technical Assessment ETA-17/0325





Table B1: Installation parameters

CMH ANCHOR	CMH 6/5	CMH 6/35		
Diameter of drill hole	d_0	mm	6	
Cutting diameter of drill bit	d _{cut}	mm	≤ 6,4	
Depth of drill hole	h₁≥	mm	40	
Effective anchorage depth	h _{ef}	mm	32	
Minimum thickness of concrete member	h _{min}	mm	80	
Maximum thickness of the fixture	t_fix	mm	5 35	
Spacing	S _{cr}	mm	200	
Edge distance	C _{cr}	mm	150	

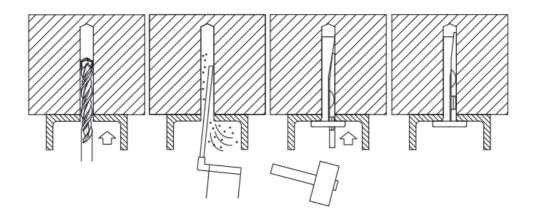

CMH ANCHOR

Intended useInstallation parameters and installation instruction

Annex B2

Table C1: Characteristic resistance (design acc. to ETAG 001, Annex C, method C)

CMH ANCHOR				CMH-6/5 CMH-6/35	
All load directions (tension and shear)					
Characteristic resistance in cracked or non-cracked concrete C20/25 to C50/60	F _{Rk}	kN	4	1,0	
Partial safety factor γ_2 -			1,0		
Shear load with lever arm					
Characteristic bending moment	$M^0_{Rk,s}$	[Nm]	6,97		
Partial safety factor γ_{M} [-]			1,25		
Displacements in cracked or non-cracked concrete C20/25 to C50/60			Tension	Shear	
Applied loads	F	[kN]	1,90	1,79	
Displacements	δ _{N0}	[mm]	1,85	0,22	
Displacements	$\delta_{N_{\infty}}$	[mm]	0,13	0,32	

CMH ANCHOR	Annex C1		
Performances Characteristic resistance	of European Technical Assessment ETA-17/0325		

Table C2: Characteristic resistance under fire exposure in concrete C20/25 to C50/60 – CMH ANCHOR (design acc. to ETAG 001, Annex C, method C)

CMH ANCHOR			CMH-6/5 CMH-6/35			
All load directions						
Fire resistance class			R30	R60	R90	R120
Characteristic resistance	$F_{Rk,fi}$	[kN]	0,21	0,19	0,14	0,10
Spacing	S _{cr,fi}	[mm]		20	00	
Edge distance	C _{cr,fi}	[mm]	[mm] 150			

The design method covers anchors with a fire attack from one side only. In case of fire attack from more than one side, the edge distance shall be \geq 300 mm.

CMH ANCHOR	Annex C2			
Performances Characteristic resistance under fire exposure	of European Technical Assessment ETA-17/0325			